



Deye

User Manual

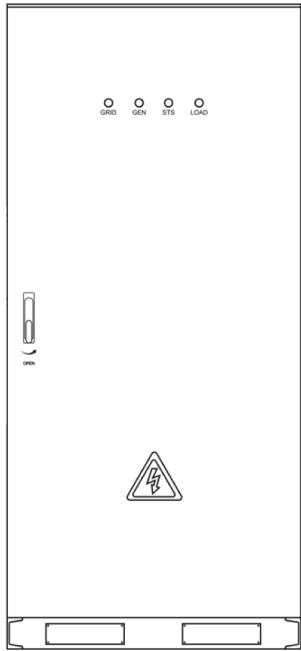

MS-BCP500-2-A

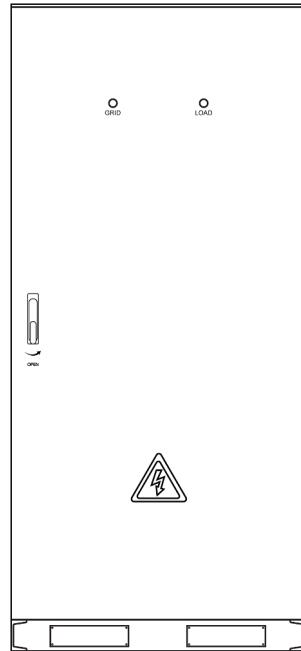

MS-BCP500-2-A

Contents

1 General information	3
1.1 All Rights Reserved	3
1.2 About This Manual	4
2 Product Description	4
2.1 Product Introduction	5
2.2 Application Scenarios	6
2.3 Product Size	7
2.4 External Overview	9
2.5 Internal Overview	10
3 Installation	12
3.1 Materials Required	12
3.2 Moving Heavy Objects	15
3.3 Unpacking	17
3.4 Hoisting	18
3.5 Installation	23
4 Electrical Connection	37
4.1 Preparation before Connection	37
4.2 Cable Connection	41
5 Operation Instructions	50
6 Maintenance	54
6.1 General Maintenance	54
6.2 Maintenance Schedule	55
7 Repair Paint Damage	60

7.1 Prerequisites.....	60
7.2 Paint Repair Description.....	60
8 Emergency Handling	66
8.1 Strong Impact.....	66
8.2 Flood.....	66
8.3 Fire.....	67
9 Storage.....	68
10 Transport.....	71
11 Technical Specifications.....	72
12 EU Declaration of Conformity.....	74

1 General information



Warning!

Read and follow carefully all safety warnings, instructions, illustrations and specifications provided with this product. Failure to follow instructions mentioned may result in electric shock, fire or serious injury.

Save all warnings and instructions for future reference.

1.1 All Rights Reserved

No part of this document can be reproduced in any form or by any means without the formal permission of the manufacturer .

Trademarks and Permissions

The trademarks used in this manual are owned by the manufacturer. All other trademarks or registered trademarks mentioned in this manual are owned by their respective owners.

Software Licenses

- * It is prohibited to use data contained in firmware or software developed by the manufacturer, in part or in full, for commercial purposes by any means.
- * It is prohibited to perform reverse engineering, cracking, or any other operations that compromise the original program design of the software developed by the manufacturer.

Disclaimer

“DANGER”, “WARNING”, “CAUTION”, “NOTICE” and “NOTE” in this manual do not represent all safety matters that should be followed, and you must also comply with relevant international, national or regional standards and industry practices. The manufacturer shall not be liable for personal injury,

property loss, product damage and subsequent losses under the following circumstances:

- * Damages caused by force majeure, including earthquake, flood, volcanic eruption, mudslide, lightning, fire, war, military conflict, typhoon, hurricane, and so on.
- * Failure to comply with the provisions of this manual.
- * The installation, operation and storage environment does not meet the relevant international, national or regional standards;
- * Incorrect use of this product.
- * Unauthorized or unqualified personnel repair the product, disassembly the rack and perform other operations.
- * Use of unapproved spare parts.
- * Unauthorized modifications or technical changes to the product or software.
- * Incorrect shipment by yourself or the third party commissioned by you.
- * Unsatisfactory materials and tools from your own that do not meet the relevant international, national or regional standards.
- * Damage caused by yourself or the third party's negligence, intent, gross negligence, improper operation, or other accidents not caused by Deye.

1.2 About This Manual

This manual mainly describes the product information, guidelines for installation, operation and so on. In this manual, "equipment" or "device" refers to relevant product, software, part, spare part or service, etc; "The manufacturer" refers to the producer, seller or service provider of the equipment.

2 Product Description

2.1 Product Introduction

This AC collection cabinet is used to manage multiple AC power sources or outputs.

Only can the product MS-TS500-2-A implement on/off-grid switching. Its main function is to switch between on-grid, off-grid modes and on/off-grid switching. When the grid is available, the system works in on-grid mode. When the grid fails and the SOC of the energy storage system (ESS) is lower than ESS SOC Threshold for Starting Up Generator, if the power plant is equipped with a generator, the generator starts and supplies power to loads. At the same time, the surplus power generated by the generator can be used to charge the ESS. When the SOC of the ESS reaches ESS SOC Threshold for Shutting Down Generator, the generator shuts down. After the grid recovers, the inverter automatically switches to grid-tied mode.

However, as for another model MS-BCP500-2-A, it is not equipped with the STS transfer switch and diesel generator input terminal blocks, which disable power supply switching. In other word, this system only works in on-grid mode or off-grid mode.




2.2 Application Scenarios

The product has a wide range of application scenarios, which can be achieved with the assistance of the EMS. The use and other detailed information of the EMS can be available through scanning the QR code:





2.3 Product Size


For MS-TS500-2-A

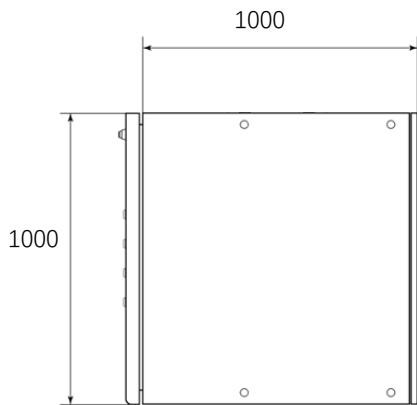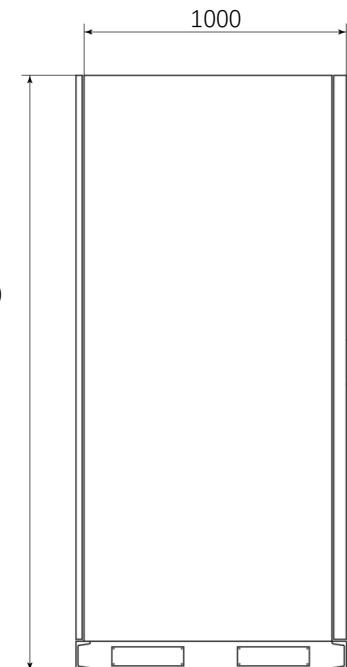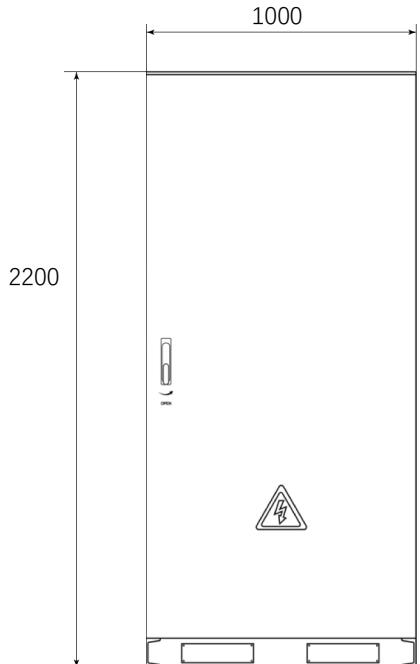

For MS-BCP500-2-A:

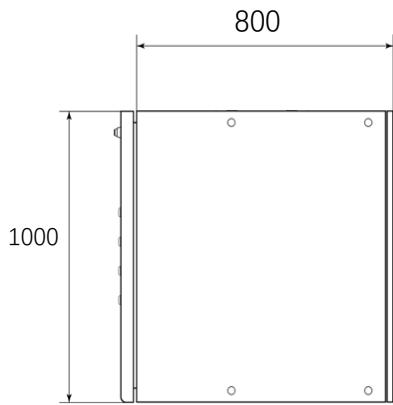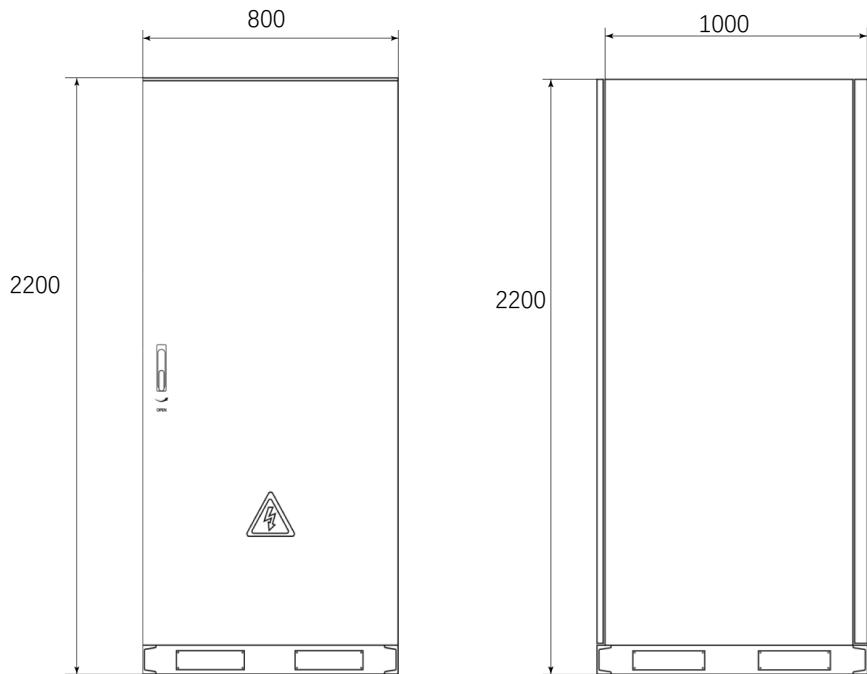


2.4 External Overview

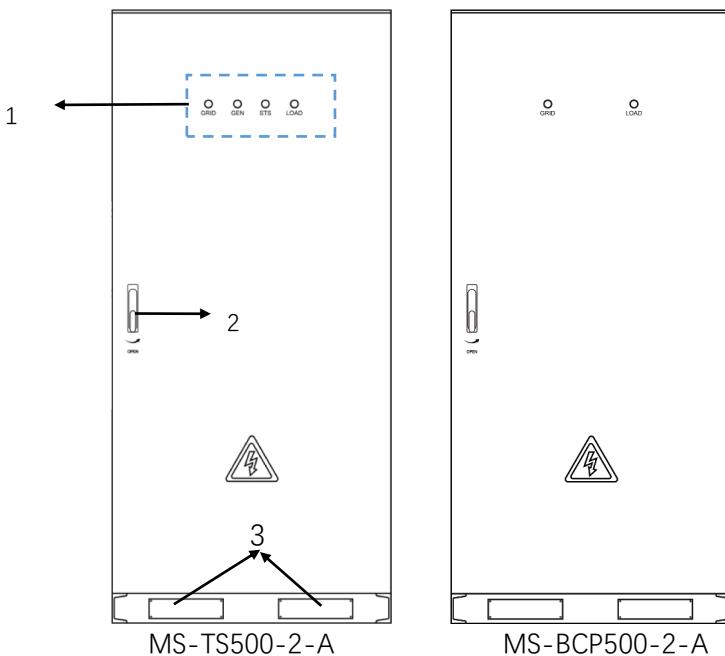


1. Indicators	GRID	The LED lights up when grid input terminals are energized
	GEN (only for MS-TS500-2-A)	The LED lights up when diesel generator input terminals are energized
	STS (only for MS-TS500-2-A)	The LED lights up when output terminals of the STS transfer switch are energized
	LOAD	The LED lights up when output terminals of the load molded case circuit breaker are energized
2. Door Lock	To control the opening and closing of the cabinet door	
3. Forklift insertion	Insertion positions of fork when moving the cabinet using a forklift	

2.5 Internal Overview

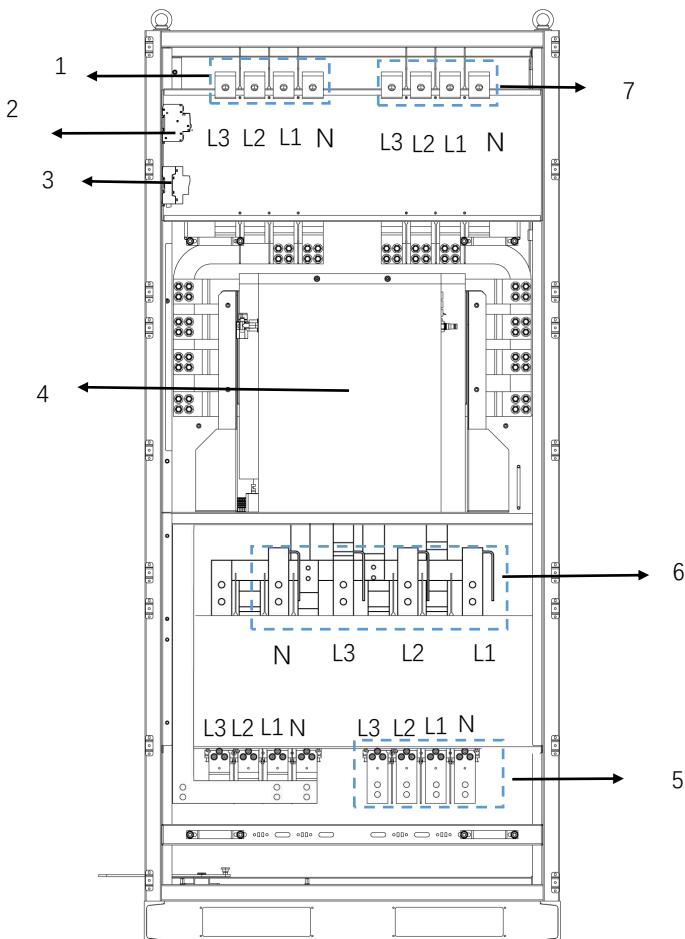








1. Grid input terminal blocks	5. Load molded case circuit breaker
2. Special circuit breaker	6. Load input terminal blocks
3. Surge protection device	7. Diesel generator input terminal blocks (only for MS-TS500-2-A)
4. STS transfer switch (only for MS-TS500-2-A)	





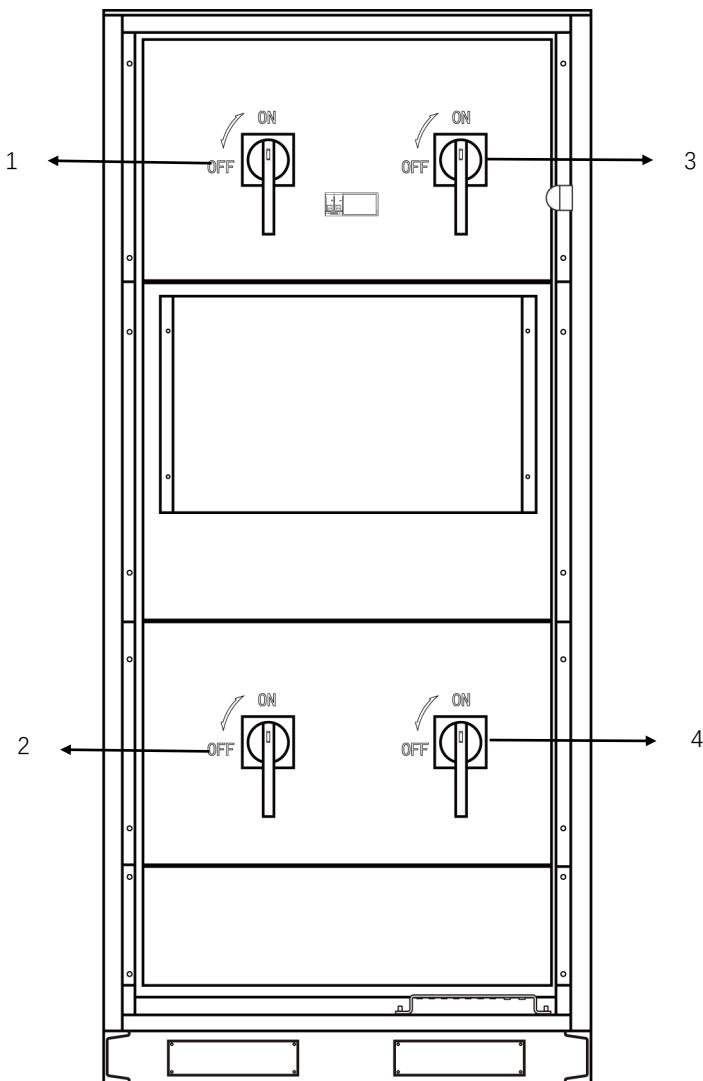



1. Diesel generator molded case circuit breaker	2. Load molded case circuit breaker
3. Grid molded case circuit breaker	4. Bypass molded case circuit breaker

3 Installation

3.1 Materials Required


Tools			
			
Hammer drill	Phillips insulated torque screwdriver	Flat-head insulated torque screwdriver	Insulated torque socket wrench
			
Diagonal pliers	Wire stripper	Cable cutter	Rubber mallet
			
RJ45 crimping tool	Hydraulic pliers	Needle-nose pliers	Marker

			
Utility knife	Steel measuring tape	Level	Multimeter DC voltage measurement
			
Heat shrink tubing	Heat gun	Cable tie	Insulated ladder
			
Powered industrial forklift	Crane		
Personal Protective Equipment			
			
Insulated gloves	Protective gloves	Goggles	Dust mask

			
Insulated shoes	Safety helmet	Protective suit	

3.2 Moving Heavy Objects


After arrival of your goods, perhaps you need move it to designated working area. Refer to the following picture for movement of heavy objects.

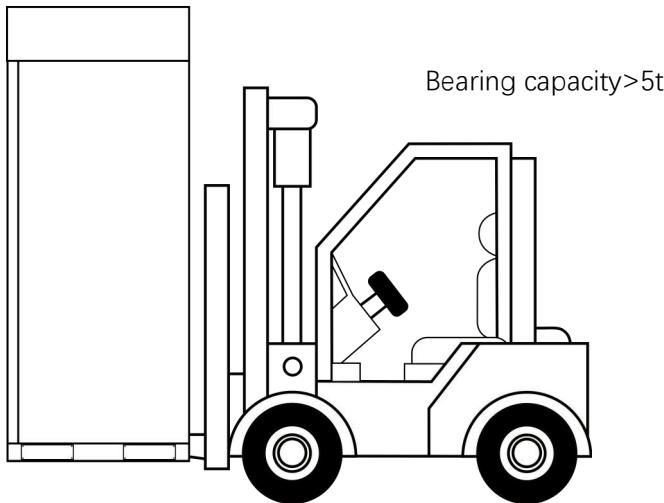

When moving your product:

- Keep at least 2m away from the forklift during operation.
- No passengers are permitted to stand on or be lifted by forklifts.
- Do not overload forklifts or raise loads too high, as this can affect overall stability.
- Maintain speeds below 3mph and avoid sharp turns.
- Before reversing, the forklift operator must check behind them and ensure it is safe to proceed.
- When reversing in confined spaces, a spotter is needed, who directs the forklift operator.

- Use caution when lifting this load on uneven surfaces.
- Never operate the forklift on slopes ≥ 5 degrees.
- During movement, avoid tilting the cabinet or placing it upside down. If the cabinet must be tilted or inverted, please straighten it as soon as possible, and the cabinet needs to be left standing for 2 hours before it can be powered on.
- Suggest to insert the forklift tooth into the position indicated by the "Forklift fork insertion: in the package material. See the following figure.
- When lifted heavy unbalanced load, refers to the marking for center of gravity location.

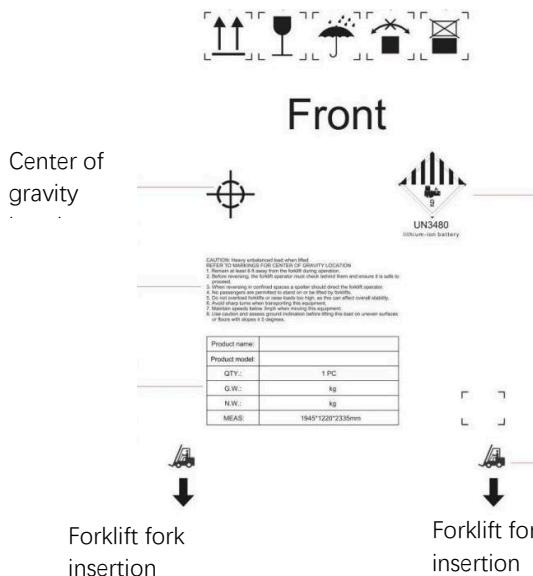

3.3 Unpacking



Warning !

- After setting up the equipment well, carefully unpack the package so as to avoid scratching equipment.
- If possible, do not remove the transport packaging before arrival at the installation site.
- After unpacking, check whether the fasteners and removable parts are missing. If they are missing, please contact you vendor at once.
- Keep the equipment stable during unpacking.
- If the installation environment is not friendly to the equipment, take measures to prevent failure inside the cabinet caused by condensation or dust corrosion (for example, cover with woven cloth or dust cover).

When it comes to package, EPE foam is broadly used for most of products, which characterizes with anti-shock and easy-disassemble.

After unpacking the equipment, check that the deliverable contents are intact and complete, and free from any damage. If any items listed in the *Packing List* is missing or damaged, contact your dealer or call service hotline:

+86-0574-86320560.

Packing List		
M30*40 Outer hexagon screw ×4	Cover Plate ×8	M10*25 Hexagon combination screw ×4
Steel Angle ×4	M30 Hanging ring ×4	M16*100 Expansion bolt ×4

3.4 Hoisting

3.4.1 Hoisting Equipment

Warning !

- The hoisting personnel must be trained and qualified until they can take up the post.
- Use only approved lifting equipment to move the cabinet system.

Warning !

- Never operate the lifting equipment in bad weather, such as typhoon, heavy rain, thick fog, thunder and so on.
- Before hoisting, ensure that the crane and hoisting ropes meet the load-bearing requirements.
- Do not drag the cabinet when assembling or disassembling the hoisting equipment. Otherwise, the cabinet may be scratched.
- Ensure that all doors of the equipment are closed and locked before hoisting.

3.4.2 Installing the Hanging rings

1. Remove four hexagon screws that are preset at the factory to prevent dust or other foreign objects entering the equipment. See the Figure.1.
2. Insert the four hanging rings into holes on the top f the machine and then turn them clockwise until they are secured firmly. See the Figure.2 and Figure.3.



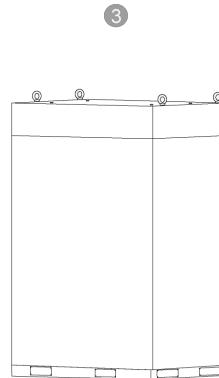


Figure.1

Figure.2

Figure.3

3.4.3 Hoisting the cabinet

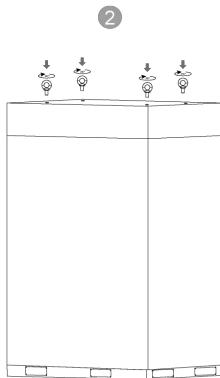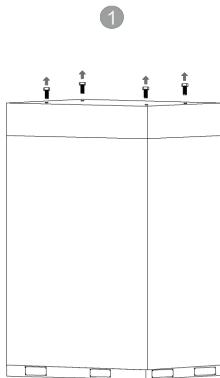

Remember to make sure that your device is connected to the lifting tool correctly and firmly before hoisting. Failure to do so may result in product damages, serious injury, even death.

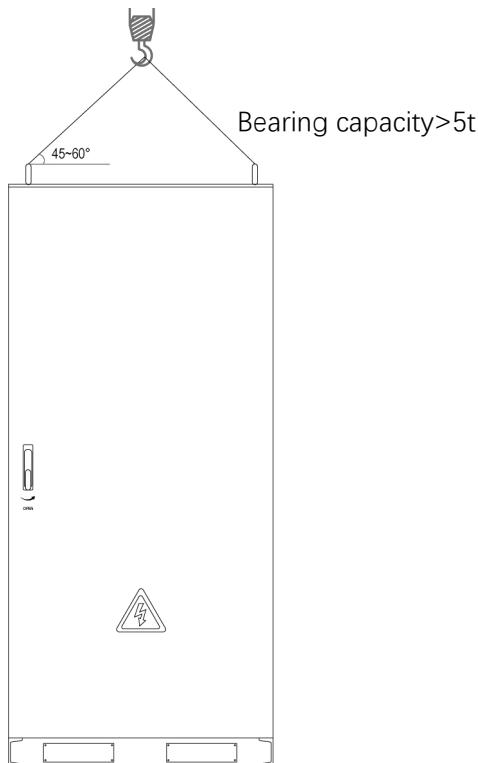


Figure.1

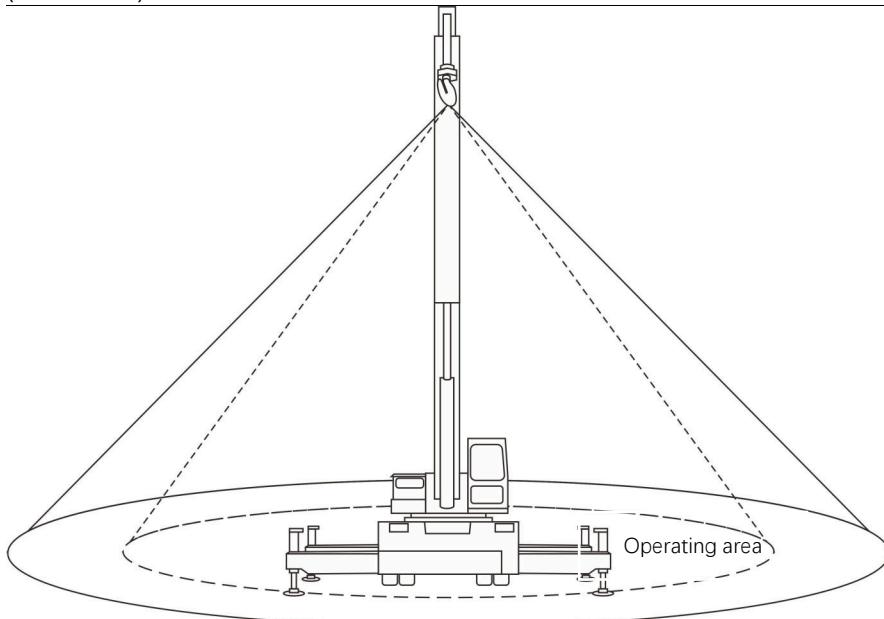


Figure.2

- Ensure that all sling connections are safe and reliable, and that the lengths of the slings connected to the corner fittings are equal. See the Figure.1
- Do not stand within 0.5-1m of the lifting area! During the whole lifting process, no one is allowed to stand under the boom or the work station. See the Figure.2
- A professional instructor is needed in the whole hoisting process.
- The length of the sling can be adjusted appropriately according to the actual requirements of installation site.
- During the lifting process, the devices must be stable and not skewed.
- Please lift the devices from the bottom.
- It is recommended to hoist the equipment from left to right or from right to left to ensure the smooth hoisting.
- Ensure that the crane position is suitable, no long distance hoisting.
- The equipment should be hoisted vertically and should not be dragged on any surface during hoisting.

- Do not shake the crane in order to avoid sudden drop or shock against equipment.
- Hoisting should be handled gently, and the cabinet should fall slowly and smoothly to avoid shock against equipment.

3.5 Installation



Warning !

- Your product is delivered without full charge. It is recommended to make your equipment charged within three months.
- Assembly must be carried out in accordance with the design, technological requirements, regulations and relevant standards.
- The parts must be cleaned before assembly, free of burrs, flash edges, oxide, rust, sand, dust and stains.
- The parts shall not be bumped, scratched or rusted during assembly.
- Wear appropriate personal protective equipment at all times during any assembly operation on site. The following personal protective equipment is considered a minimum requirement:
 - In a dry environment, wear S3 safety shoes .
 - On rainy or wet ground, wear S5 safety boots .
 - Wear flame-retardant work clothes.
 - Wear flame-retardant work pants.
 - Safety gloves.

3.5.1 Installation Requirements

3.5.1.1 Installation Personnel

- Only qualified professionals or trained personnel are allowed to install, the equipment.
 - Professionals:personnel who are familiar with the working principles and structure of the equipment, trained or experienced in equipment operations and are clear of the sources and degree of various potential hazards in equipment installation.
 - Trained personnel:personnel who are trained in technology and safety

have required experience, are aware of possible hazards on themselves in certain operations and are able to take protective measures to minimize the hazards on themselves and other people.

- Personnel who plan to install the equipment must receive all necessary safety precautions and local relevant standards.
- Only qualified professionals are allowed to remove safety facilities and inspect the equipment.
- Knowledge of electronic, electrical wiring and mechanical expertise, and be familiar with electrical and mechanical schematics.
- Understanding and complying with this document and other applicable documents.

3.5.1.2 Installation site requirements

Danger!

Do not expose the equipment to flammable or explosive gas or smoke.
Do not perform any operation on the equipment in such environments.

Danger!

Do not store any flammable or explosive materials in equipment area.

Danger!

Do not place the equipment near heat sources or fire sources, such as smoke, candies, heaters, or other heating devices. Overheat may damage the equipment or cause a fire.

Warning!

Install the equipment in an area far away liquids. Do not install it under areas prone to condensation, such as under water pipe and air exhaust vent, or area prone to water leakage, such as air conditioner vents, or ventilation vents.
Ensure that no liquid enters the equipment to prevent faults or short circuits.

Warning!

To prevent damage or fire due to high temperature, ensure that the ventilation vents or heat dissipation systems are not obstructed or covered by other objects while the equipment is running.

- The installation and usage environment must meet relevant international, the local laws and regulations. The user is obliged to protect the equipment against fire or other hazards.
- Do not install in low-lying areas. The installation level must be at least 300mm higher than the highest water level in the area.
- To protect the equipment from wildfires caused by high temperatures in summer, it should be free of vegetation and flammable plants within 3 meters of the surrounding area.
- Considering safety, the distance between the equipment and residential buildings should be more than 12m, and the distance between the equipment and schools, hospitals and other densely populated buildings should be more than 30.5m. If this safety distance cannot be met, a firewall should be built between the equipment and the building.
- The safe distance between the equipment and the production building shall comply with local fire codes or standards.
- Outdoor storage systems should be at least 10 feet away from boundaries, public roads, buildings, flammable materials, hazardous materials, high piles, and other hazards not associated with the grid infrastructure.
- The equipment should be installed in an environment free from the risk of explosion.
- Reserve enough space for expansion according to the needs of the whole life cycle.
- Ensure that the equipment is installed in a clean, dry and well ventilated area with proper temperature, humidity ,altitude range and so on. Check for more data in the "**Technical Specifications**" section.
- Do not install the equipment in salt-damaged or polluted areas because they may be corroded. This product can be used in the following or better environments:
 - In a place where is 2000m far away from the coast. It is not recommended to use the product when it within 500m to 2000m away from the coast . The equipment cannot be used when the distance from the coast is less than 500m .
 - In a place where the distance from heavy pollution sources, such as smelters, coal mines, thermal power plants, is more than 1500m at least.
 - In a place where the distance from moderate pollution sources such as

chemical, rubber, and electroplating is more than 1000m at least.

-In a place where the distance from light pollution sources such as food, leather, heating boilers, slaughter houses, centralized garbage dumps, and sewage treatment stations is more than 500m at least.

- Keep the equipment out of the reach of children and away from daily working or living area, including but not limited to the following areas: studio, bedroom, lounge, living room, music room, kitchen, game room, room theater, sunroom, toilet, bathroom, laundry, and attic.
- Do not install the equipment in places without proper fire fighting facilities, or difficult for firefighters to access.
- Do not install the equipment in an easily accessible position because the temperature of the enclosure and heat sink is high when the equipment is running.
- Do not install the equipment on a moving object, such as ship, train, or car.
- Do not install the equipment in an environment with magnetic dust, volatile or corrosive gases, infrared and other radiations, organic solvents, conductive metal, or salty air.
- Do not install the equipment in an area conducive to growth of microorganism such as fungus or mildew.
- Do not install the equipment in an area with strong vibration, noise, or electromagnetic interference.
- Do not install the equipment in a position that may be submerged in water.

3.5.1.3 Foundation requirements


Unreasonably constructed foundation will bring great troubles to the installation of the equipment, affecting the normal opening and closing of the doors and the normal operation. Therefore, the foundation of the equipment must be designed and constructed according to certain standards to meet the requirements of mechanical support, cable routing and later maintenance and overhaul. At least the following requirements shall be met during foundation construction:

- The equipment must be installed on concrete or other non-combustible surfaces. Ensure that the foundation is level, firm, and smooth, and has sufficient bearing capacity. No sag or tilt is allowed.
- Ensure that the ground in the installation environment is solid, free from spongy or soft soil, and not prone to subsidence. The site must not be located in a low-lying land prone to water or snow accumulation.
- The cross-sectional area and height of the foundation should vary according to equipment dimension.
- Construct corresponding drainage in conjunction with local geological conditions.
- Consider cable routing when building the foundation.
- Build a maintenance platform around the foundation to facilitate later maintenance.
- During the foundation construction, reserve enough space for the AC/DC side cable trench according to the position and size of the cable inlet and outlet holes of the equipment and related machines, and preset the cable conduit. Determine the specifications and quantity of the perforating gun according to the model and quantity of the cables.
- Both ends of all embedded pipes should be temporarily sealed to prevent impurities from entering and causing troubles to later wiring.
- After all cables are connected, cable inlet and outlet and connector should be sealed with fireproof mud or other suitable materials to prevent rodent access.


- The dregs excavated during the foundation construction should be removed immediately to avoid affecting the hoisting in the later stage.



The foundation drawing cannot be used as the final construction drawing but only for reference. Users must verify the design parameters of the energy storage system foundation based on the installation environment, ground bearing capacity, geological conditions, and seismic requirements of the project site.

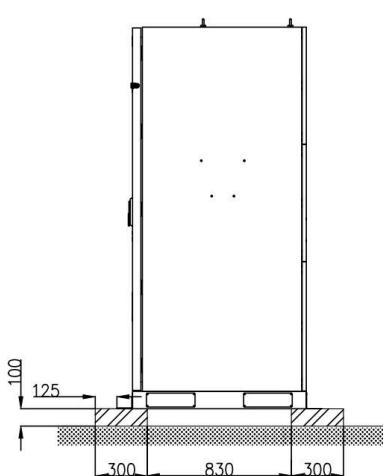

load-bearing surface

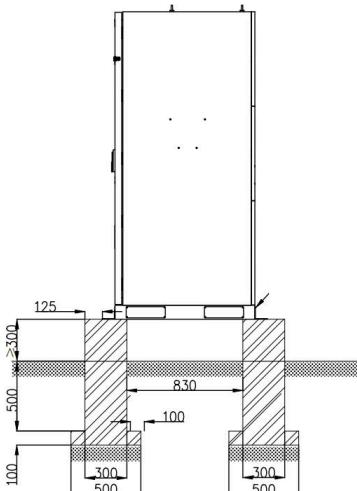


non-load-bearing surface


3.5.1.4 Installation clearance requirements

Danger!

No one is allowed to pass within 1.5m behind the cabinet, otherwise this person may be hurt when explosion.

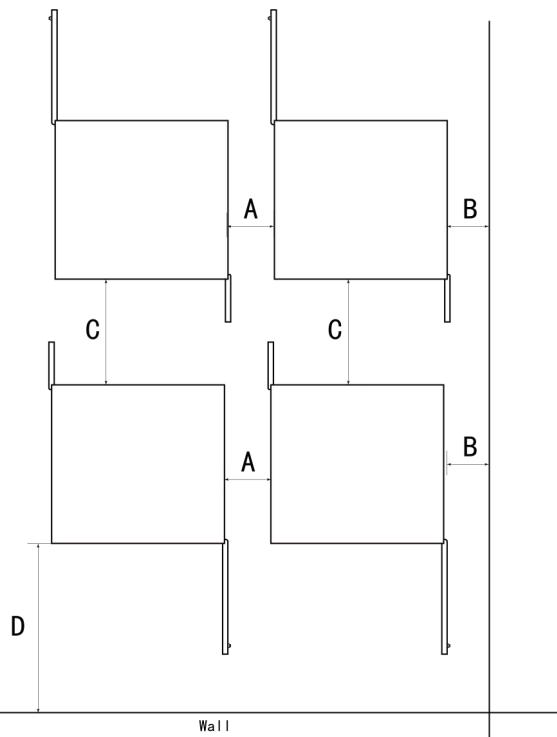

Serial number	Distance (mm)
A	150
B	150
C	800
D	1500

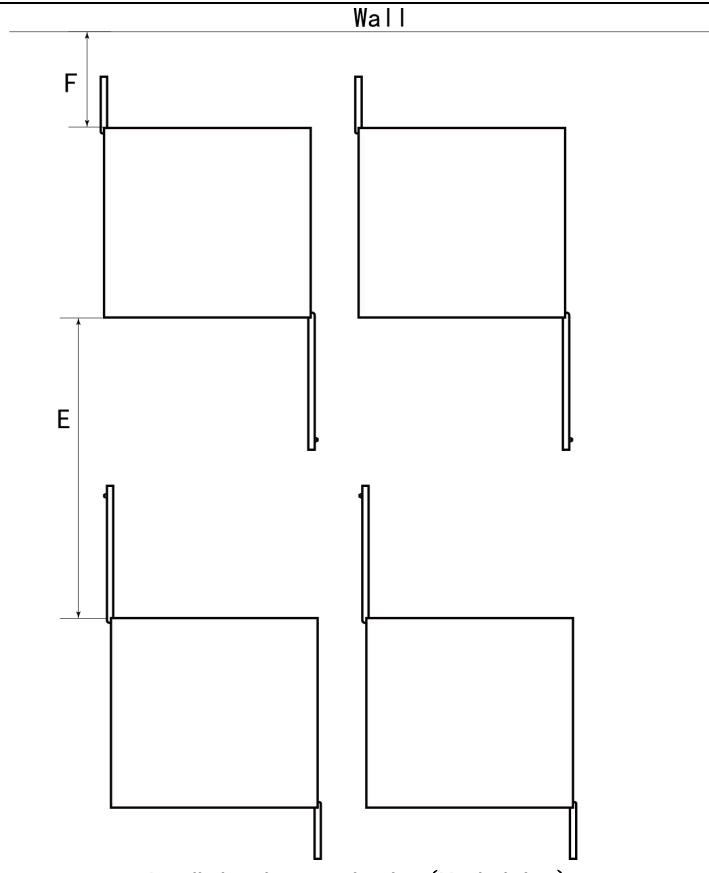


Installation clearance drawing (Vertical view)

Serial number	Distance (mm)
E	3000
F	1500

3.5.2 Assembling the Boards

Making sure that the cabinet has been seated well, you need to attach one board onto every hole for forklift fork insertion, which is used to prevent dust or other foreign objects entering the machine.

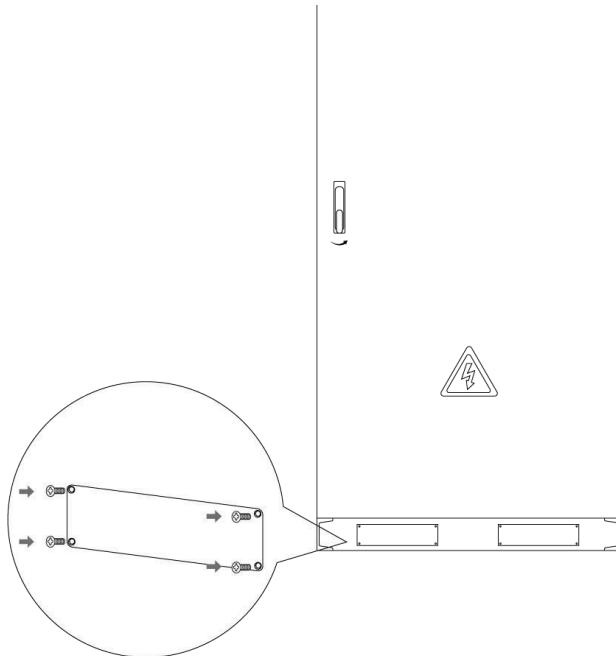

3.5.3 Fixing the cabinet

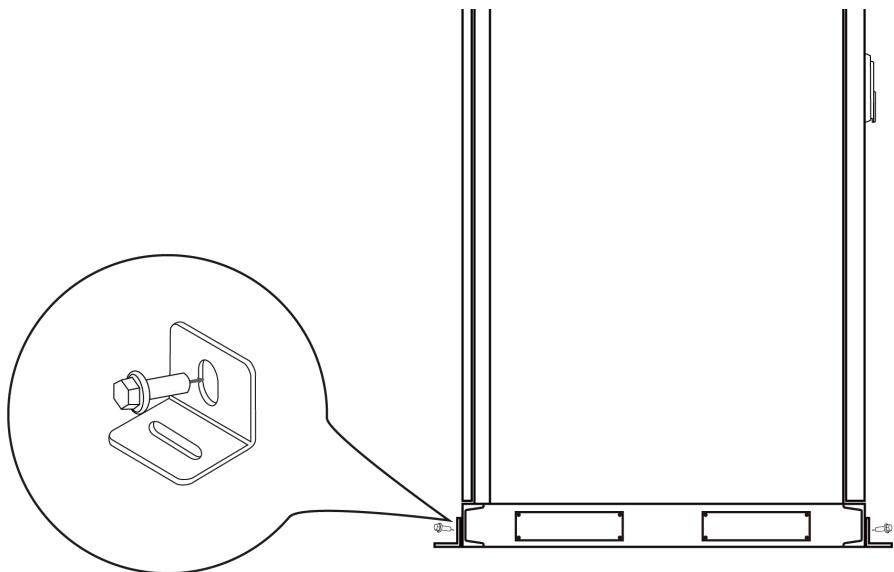


Figure.1-2

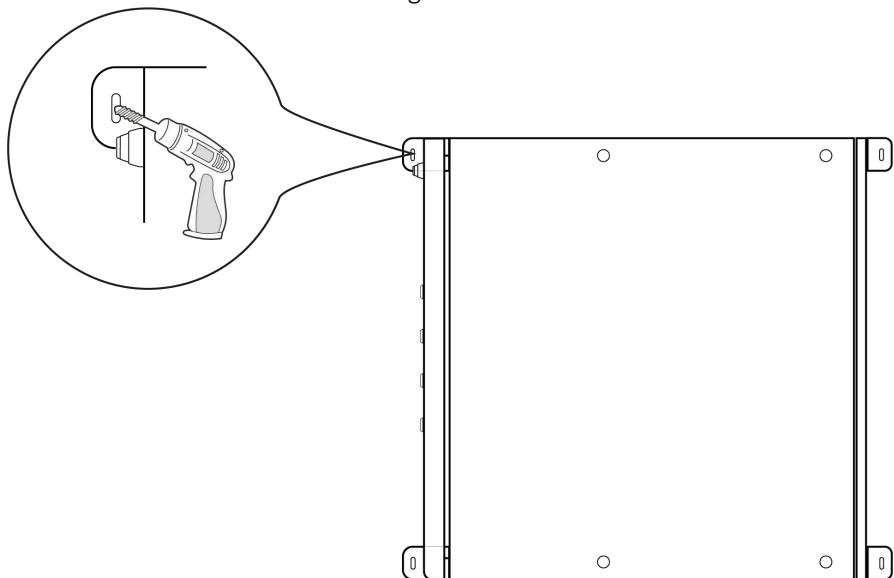


Figure.1-2


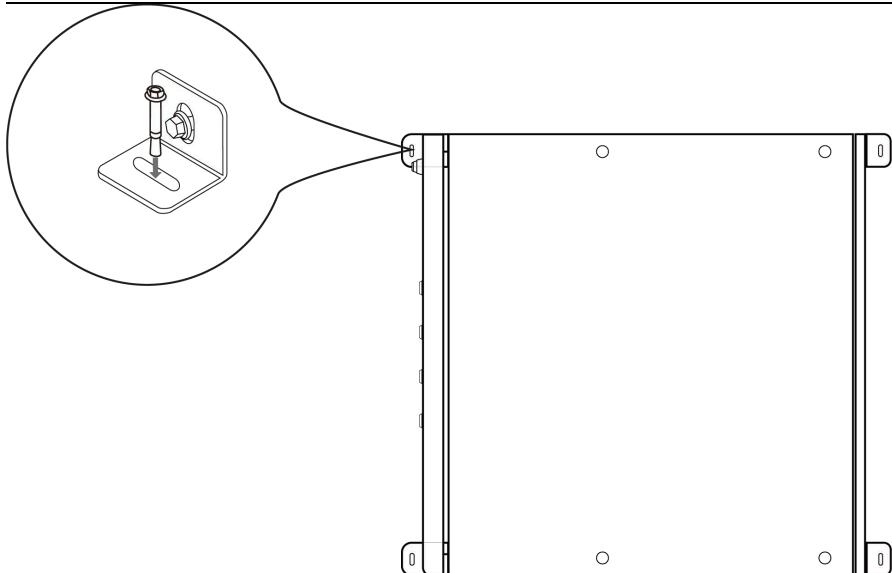


Figure.1-3


1. Locate four mounting holes, 2 holes on the front of the cabinet and others on the back.
2. If your product is shipped with 4 L-shaped angle steels, fix them to the cabinet using 4 screws (M10*25). (Figure.1-1)
3. After the step 2 is finished, you need to drill 4 holes on the ground using an electric hammer. (Figure.1-2)
4. Fix the 4 angle steels to the ground using 4 expansion screws (M16*100). (Figure.1-3)

3.5.4 Install the EMS (Optional)


1. Secure the mounting board onto the AC collection cabinet with bolts (M6*20).

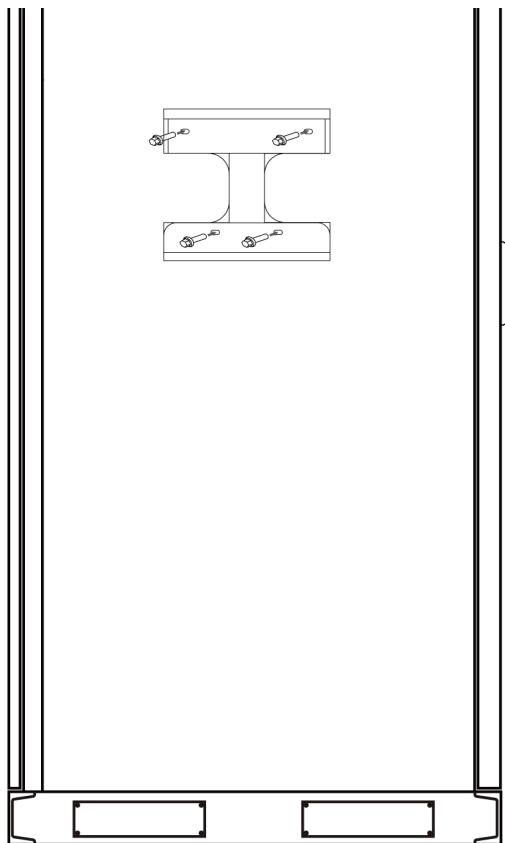

2. Fix two backplane to the back of EMS cabinet with 8 bolts (M6*20).Tighten them.

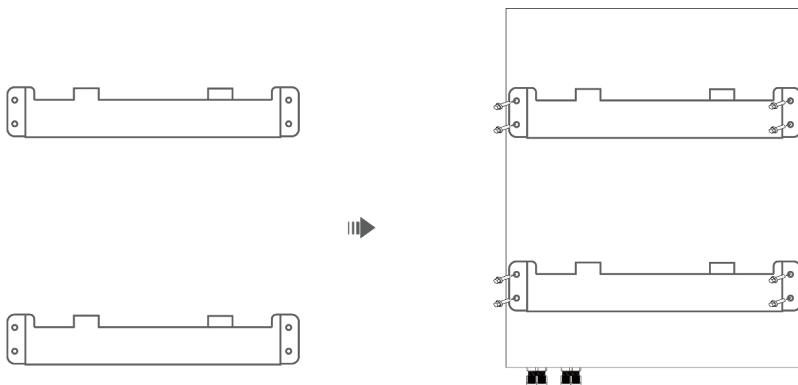

3. Lift the EMS and hook it onto the mounting board. Ensure that the upper and lower hooks of the backplane are accurately buckled on the mounting board.

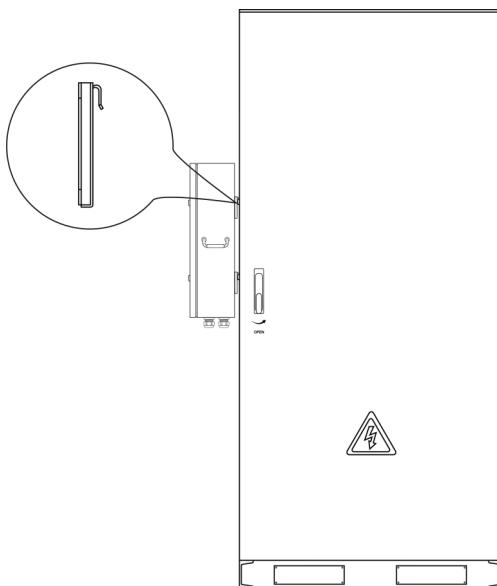

4 Electrical Connection

4.1 Preparation before Connection



Caution !

If the generator deployed in the power plant runs in off-grid mode and the load power exceeds the generator capacity, the generator may shut down due to overload. You are advised to shut down some loads.



Warning !

- Sand and moisture infiltration can damage the electrical equipment in the container or affect its operating performance!
- Do not perform electrical connections during sandstorms or when the relative humidity of the surrounding environment is greater than 95%.
- Make electrical connections when there is no wind or sand and when the weather is clear and dry.
- Before connecting cables, check that the polarity of all input cables is correct. Do not pull wires and cables forcibly during electrical installation.
- Otherwise, the insulation performance may be affected. Make sure all cables and wires have enough room to bend. Take necessary auxiliary measures to reduce the stress on cables and wires.
- After each connection is complete, carefully check whether the connection is correct and secure.

4.1.1 Cable Requirements


When wiring, cables are supposed to meet the following requirements:

- Sufficient current-carrying capacity. Factors that can influence this capacity are shown as follows:
 - environment condition;
 - the type of insulated materials of conductors;
 - cable routing;
 - material and cross-section of cables;
- Suitable diameter and length of cables
- Correct specification and material of cables used for DC input
- Correct specification and material of cables used for AC input
- Only use fire-resistant cables.

How to crimp an OT or DT terminal?

Notice!

- Avoid scratching the core wire when stripping a cable.
- The cavity formed after the conductor crimp strip of the OT terminal is crimped must wrap the core wire completely. The core wire must make close contact with the OT terminal.
- Wrap the wire crimping area with heat shrink tubing or insulation tape. The heat shrink tubing is used as an example.
- Use a heat gun carefully to avoid heat damage to the equipment.

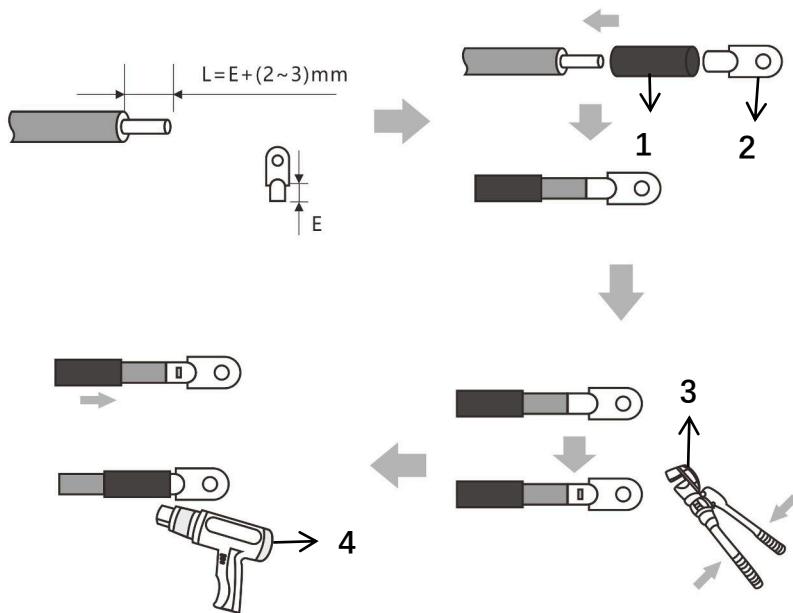

NO.	Description	NO.	Description
1	Hot air duct	3	Hydraulic pliers
2	OT/DT	4	Heat Gun

4.1.2 Opening the Door




Figure.1




Figure.2




Figure.3




Figure.4

1. The door of the cabinet is in locked state.See the Figure.1
2. Move upward the cover above the keyhole.See the Figure.2
3. Insert the door key and turn it clockwise to eject the handle.See the Figure.3.
4. Turn the handle clockwise and pull out the door.See the Figure.4

4.2 Cable Connection

Danger!

All electrical connections must be made when the equipment is completely powered off.

Danger!

Do not smoke or have an open flame around the equipment. Wear personal protective equipment and use dedicated insulated tools to avoid electric shocks or short circuits.

Warning!

- Equipment damage caused by incorrect connections is not covered by the product warranty.
- Only qualified electrical technicians are allowed to connect cables.
- Operation personnel must wear proper PPE when connecting cables.

Warning!

When connecting cables, do not place installation tools, metal parts, or sundries on the equipment. After the connection, clean up objects around the area.

Caution!

- Do not connect two or more cables to the positive or negative power port at the same time.
- Stay away from the equipment when preparing cables to prevent cable scraps from entering the equipment. Cable scraps may cause sparks and result in personal injury and equipment damage.


4.2.1 Grounding

⚠ Warning !


Ensure that the ground cable is securely connected. Otherwise, electric shocks may occur.

⚠ Note !


- The grounding point at the AC output port is used only as a protective earthing equipotential bonding point, and cannot substitute for the grounding point on the enclosure.
- It is recommended that silicone grease or paint be applied around the ground terminal after the ground cable is connected.

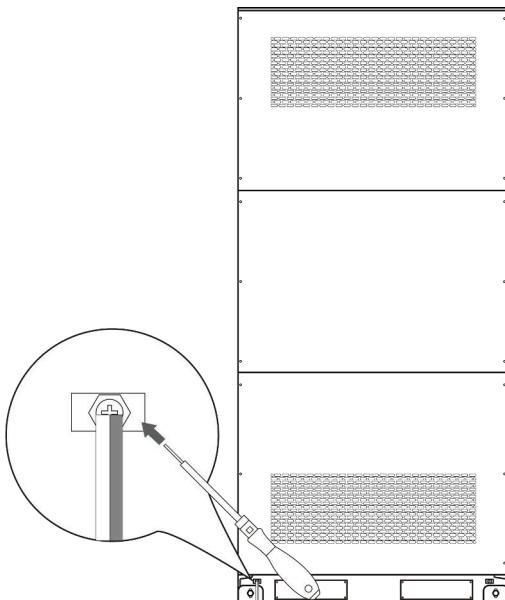


4.2.2 Grid

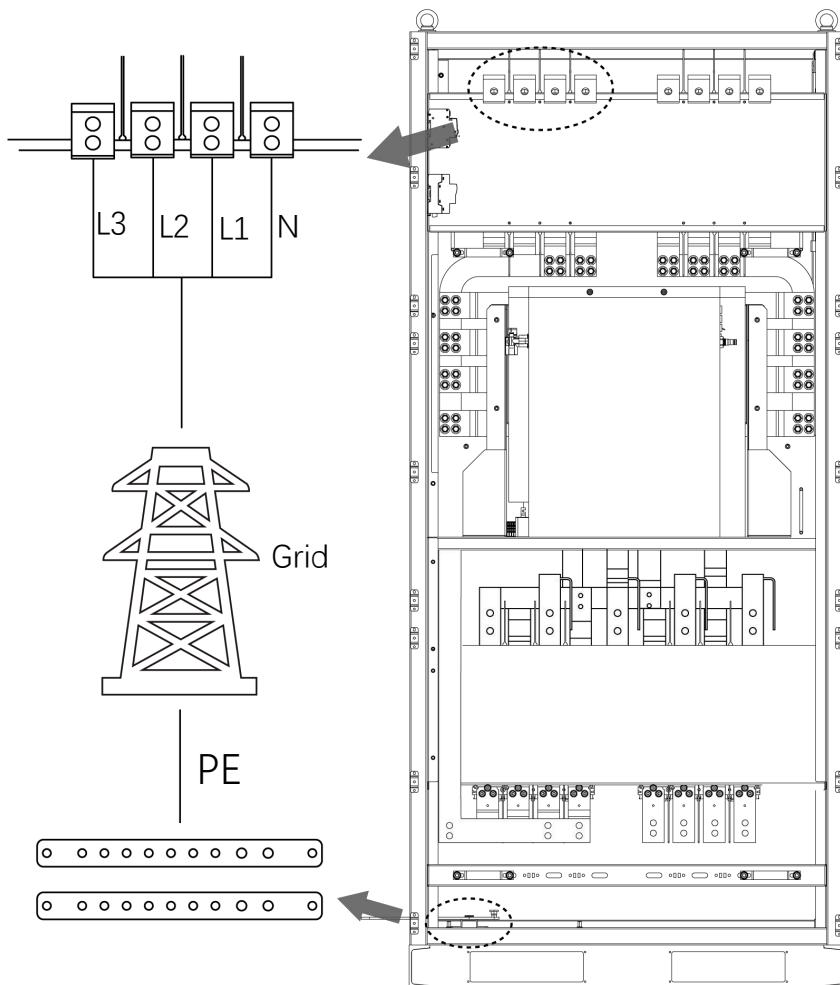


4.2.3 Diesel Generator (only for MS-TS500-2-A)

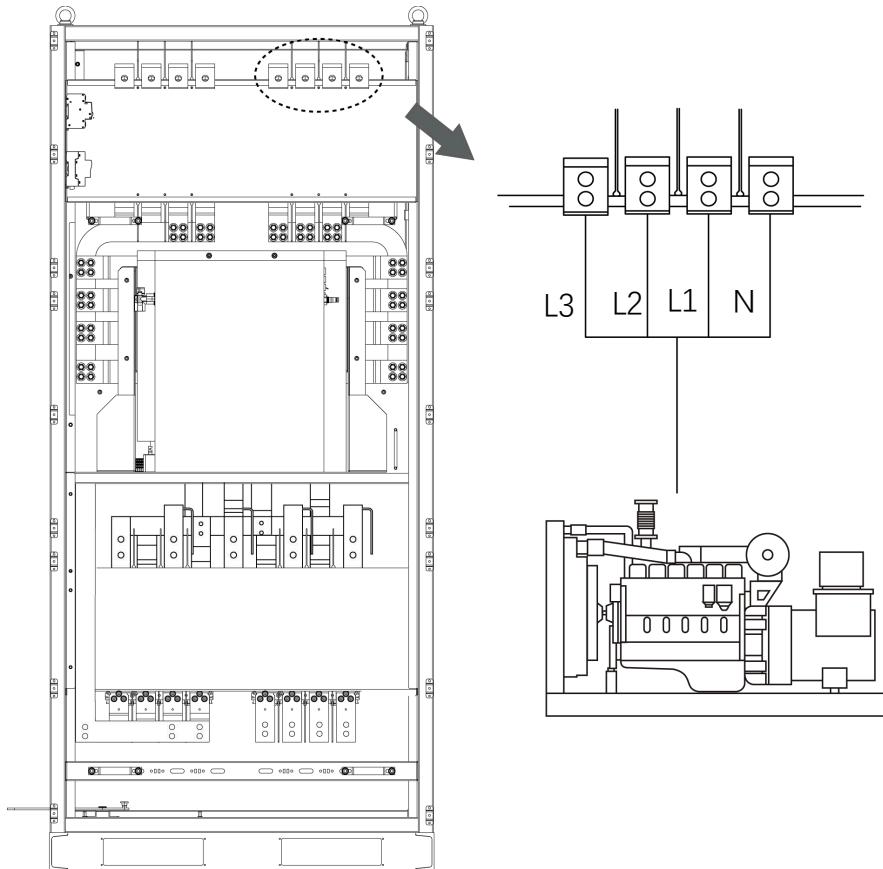

4.2.4 Load

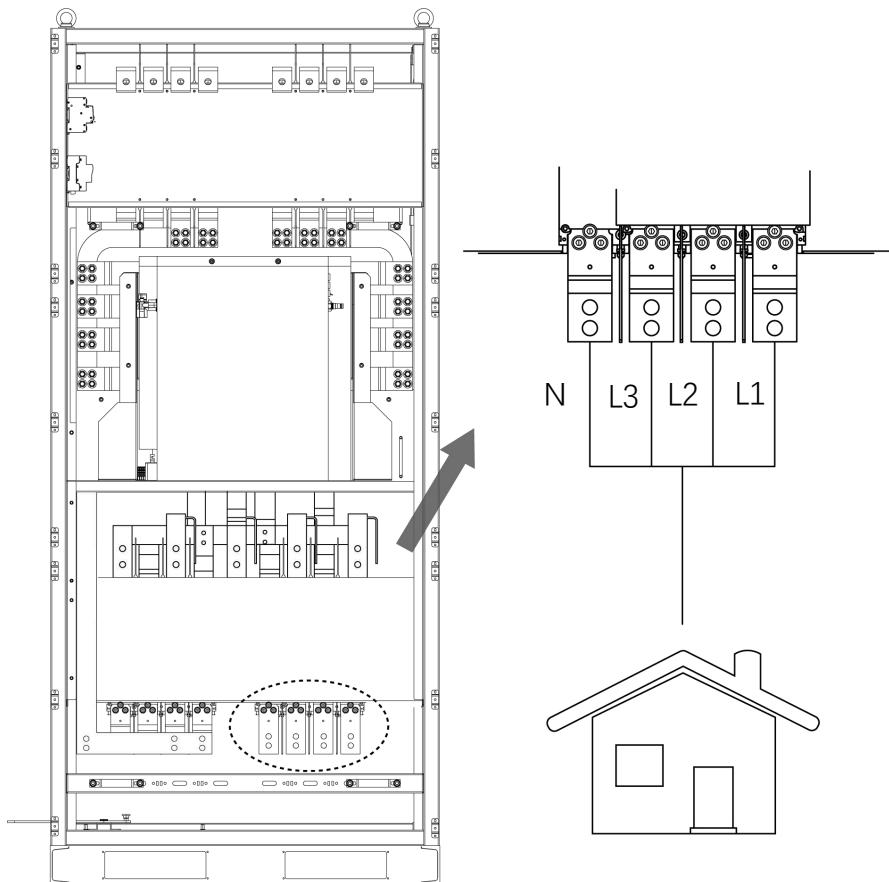

4.2.5 Attaching to EMS (Optional)

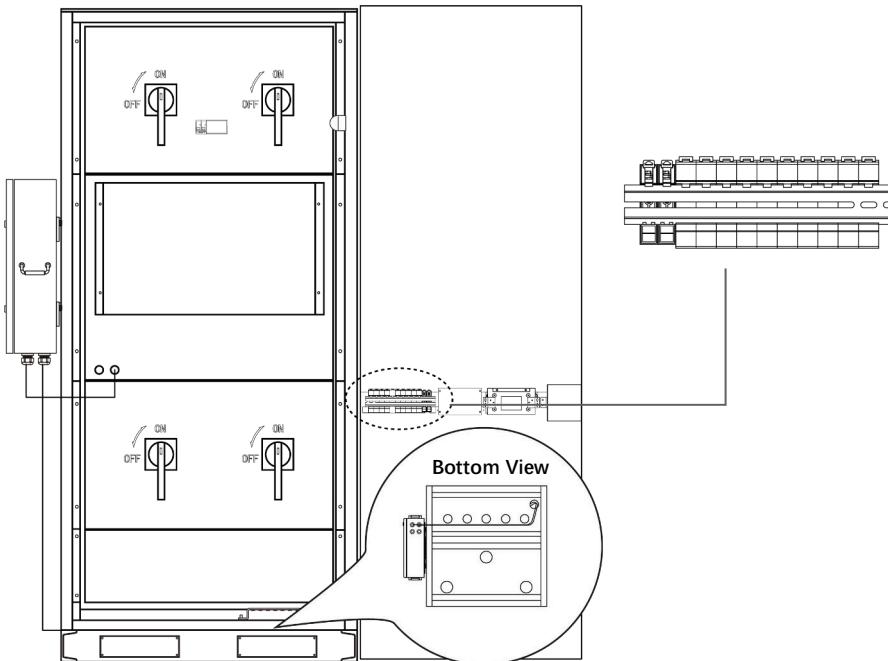


4.2.6 Attaching to ESS (GS215)




Note!

The quantity of energy storage systems to be connected to the AC collection cabinet cannot exceed 5.

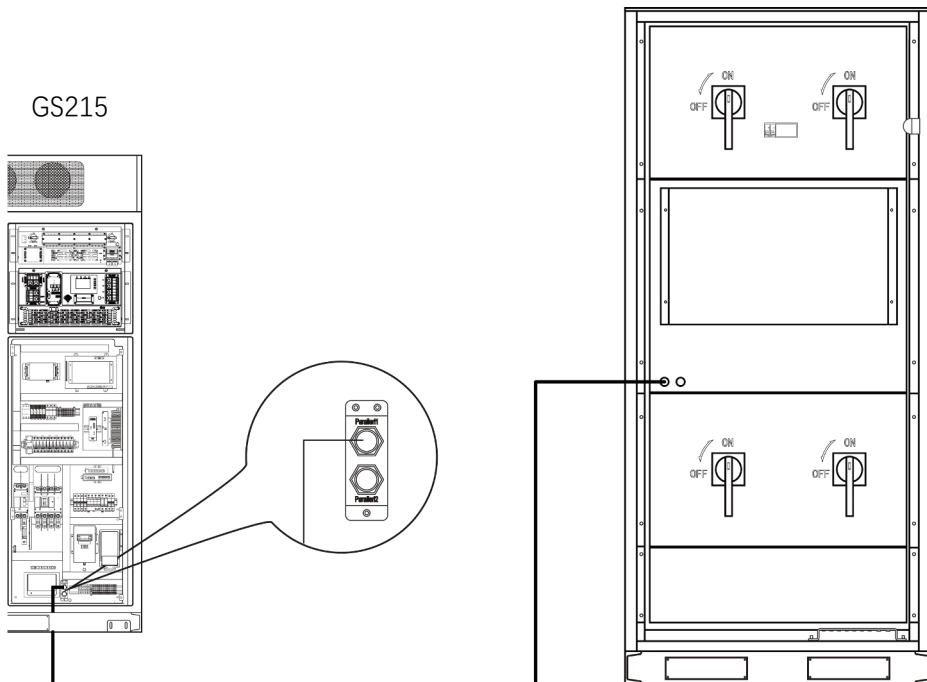

Step 1

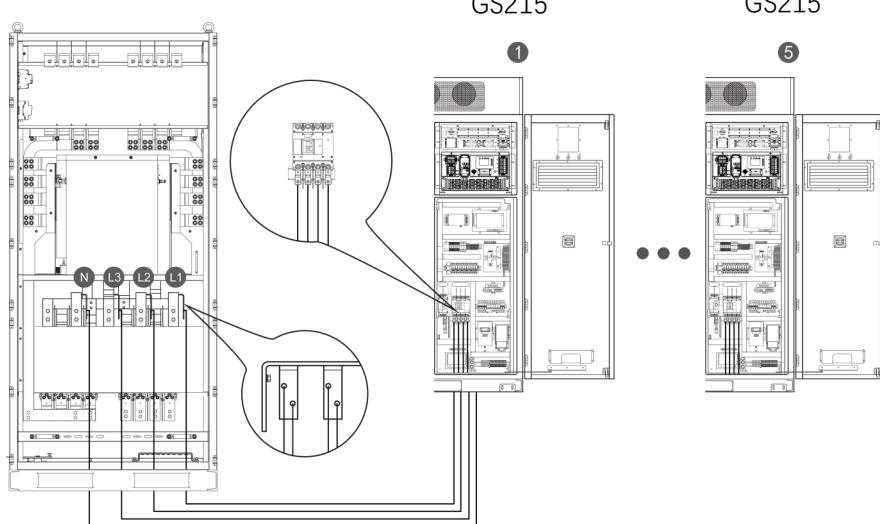


Step 2



Note !
When integrating the GS215 into the system, ensure that the quantity does not exceed five units. Additionally, each hole on the ESS input terminal block located on the side is designed to accommodate a maximum of two cables.

4.2.7 Attaching to MC-L430

To expand capacity, your equipment is equipment with capacity expansion copper bars so as to work together with other energy storage systems such as MC-L430. It is recommended to connect 2 MC-L430 systems at most.

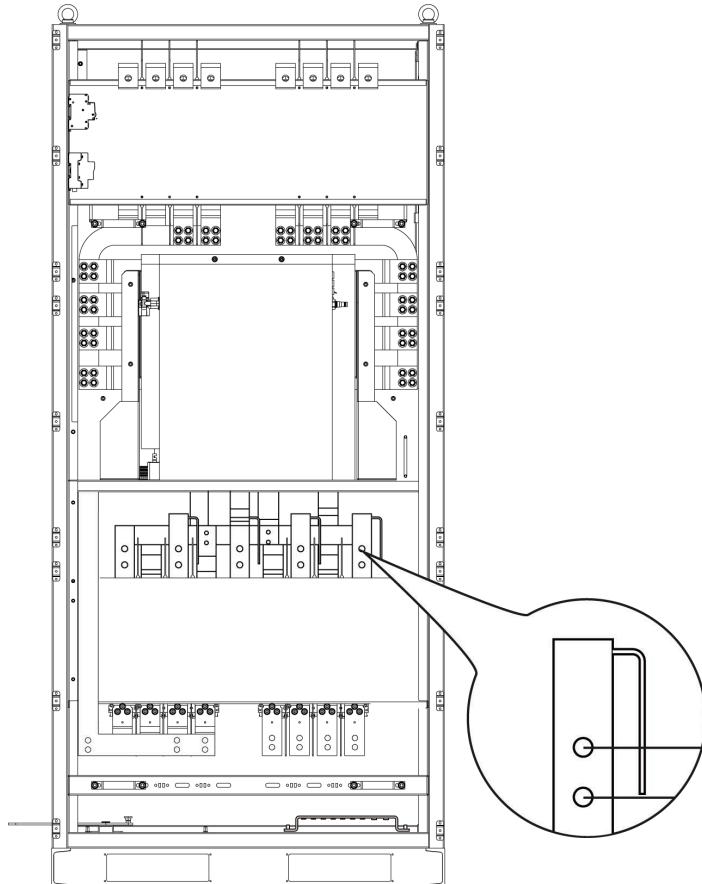

5 Operation Instructions

5.1 Check Before Operation

General Check

No.	Check Item	Acceptance Criteria
1	Appearance	<ul style="list-style-type: none">The equipment is intact and free from rust or paint flake-off. If the paint flakes off, repair the damaged paint.The labels on the device are clear. Damaged labels must be replaced.
2	Cable appearance	<ul style="list-style-type: none">Cable sheathings are properly wrapped and not damaged.Cable hoses are intact.
3	Cable connection	<ul style="list-style-type: none">Cables are connected in the designed positions.Terminals are prepared as required and securely connected.Labels on both ends of each cable are clear and specific, and attached in the same direction.
4	Cable routing	<ul style="list-style-type: none">Cables are neat and tidy.Cable tie joints are evenly cut without burrs.Cables are placed properly and with slack at bending points to avoid stress.Cables are routed neatly without twists or crossovers in the cabinets.

Cabinet

No.	Check Item	Acceptance Criteria
1	Installation	<ul style="list-style-type: none">• The installation meets the design requirements.• The cabinet is level, and each door opens normally.
2	Appearance	<ul style="list-style-type: none">• The cabinet surface is free from cracks, dents, and scratches. If the paint flakes off, repair the damaged paint.
3	Accessory	<ul style="list-style-type: none">• The number and positions of accessories installed meet design requirements.
4	Label	<ul style="list-style-type: none">• All labels are correct, clear, and complete.

Interior

No.	Check Item	Acceptance Criteria
1	Cable	The bolts for installing the cables are tightened and the cables are not loose.
2	Cable hole sealing	Cable holes are sealed.
3	Components	All components are intact.
4	Foreign object	Foreign objects such as tools and remaining materials are cleared.
5	Cabinet grounding	The ground conductor is securely connected to the ground terminal of the cabinet.

5.2 Working Mode

When your product (MS-TS500-2-A) is equipped with the STS transfer switch, this device automatically switches from on-grid mode to off-grid mode based on actual conditions and working conditions. Otherwise, your equipment (MS-BCP500-2-A) is supplied power by the grid.

Power supply priority: on-grid > generator off-grid.

5.3 Power On/Off Operation



Wear insulated gloves and use insulated tools to prevent electric shocks or short circuits.



- During the power-on procedure, monitor the system for faults. If you detect any faults, power off the equipment, rectify the faults, and then continue with the procedure.
- If the equipment has not been used for six months or longer after being installed, it must be checked and tested by professionals before operation.
- Turn on the circuit breaker only after you have confirmed that there is no short circuit or other fault to prevent the fault from spreading and causing safety risks.



Before the equipment is put into operation for the first time, ensure that the parameters are set correctly by professional personnel. Incorrect parameter settings may result in noncompliance with local grid connection requirements and affect the normal operations of the equipment.

Step	Name	Description
1.	Turn on/off the diesel generator molded case circuit breaker (only for MS-TS500-2-A)	To control the connection or disconnection of diesel generator by turning the handle clockwise or anticlockwise
2.	Turn on/off the grid generator molded case circuit breaker	To control the connection or disconnection of grid by turning the handle clockwise or anticlockwise
3.	Turn on/off the ESS molded case circuit breaker(GS215)	To control the connection or disconnection of ESS by moving the button upward or downward
4.	Turn on/off the load molded case circuit breaker	To control the connection or disconnection of loads by turning the handle clockwise or anticlockwise

6 Maintenance

6.1 General Maintenance

Danger!

- Servicing should be performed or supervised by professional personnel.
- Wear personal protective equipment and use dedicated insulated tools to avoid electric shocks or short circuits
- Do not smoke or have an open flame around the equipment.
- Do not use wet cloth to clean exposed copper bars or other conductive parts.
- Do not use water or any solvent to clean the equipment.
- Do not wear jewelry, watches and other metal jewelry when servicing.

Caution!

- Place a warning sign indicating that switch must not be turned on at the position where the switch resides.
- Before performing maintenance or repair, securely connect the loop to be repaired to the main ground loop using a ground cable.
- After the maintenance or repair is complete, remove the ground cable between the loop that has been maintained and the main ground loop.
- Stay away from the equipment when preparing cables to prevent cable scraps from entering the equipment. Cable scraps may cause sparks and result in personal injury and equipment damage.
- Cables should be inserted and removed in accordance with regulations. Violent or brute force operations are prohibited.
- After the maintenance is complete, clean the tools and materials in time, and check whether metal objects remain inside or on the top of the product.
- If you have any questions about the operation and maintenance of this product, please contact the customer service center. Do not operate without authorization.

6.2 Maintenance Schedule

6.2.1 Quarterly Maintenance

Maintenance Category	Maintenance Action	Expected Result
Safety inspection	Check that all switches to shut off the equipment can work normally	● All switches can work normally
Cabinet	Perform the visual inspection: <ul style="list-style-type: none">● Rust condition● Settings	● There is no obvious paint peeling or rust. ● Meet technical requirements in normal run.

6.2.2 Semi-annual Maintenance

Maintenance Category	Maintenance Action	Expected Result
Outside the cabinet	Perform the visual inspection: <ul style="list-style-type: none">● Inflammable materials.	There is no any inflammable objects around the cabinet.
Cabinet	Perform the visual inspection: <ul style="list-style-type: none">● Appearance● Rust condition● Door lock● Fasteners● Settings	<ul style="list-style-type: none">● There is no obvious paint peeling or rust.● The door locks are not damaged.● There are no insects, rodents, snakes or other animals.● All fasteners are secured firmly.● All technical settings can support the normal run of the equipment.
Cables	<ul style="list-style-type: none">● Check whether cables are securely connected.● Check whether cables are damaged, especially whether the cable sheath that contacts a metal surface is damaged.● Check whether water is entering into the cabinet	<ul style="list-style-type: none">● Cables are securely connected.● No damages are found on the cables.● No water enters the equipment and contacts with cables.● There are no insulating tape is peeling off.● Cable routing is performed correctly

	<ul style="list-style-type: none">● Check whether any insulating tape on terminals is not detached.● Check whether all cables are routed correctly.	and reasonably
Grounding reliability	<ul style="list-style-type: none">● Check whether the PE cable is securely connected.	The PE cable is securely connected.

6.2.3 Annual Maintenance

Maintenance Category	Maintenance Action	Expected Result
System	<p>Perform the visual inspection:</p> <ul style="list-style-type: none">● Appearance● Temperature and humidity● Dust● Rust	<ul style="list-style-type: none">● There is no obvious deformation inside the cabinet.● Temperature and humidity are in normal ranges.● There is no obvious noise when interior devices are in normal run.● There is no rust inside the cabinet.
Alert labels	<ul style="list-style-type: none">● Check the warning labels.	<ul style="list-style-type: none">● All warning labels are visible, and no damages or stains on them.
Protection devices and indicators	<p>Perform the visual inspection:</p> <ul style="list-style-type: none">● Fuse● Surge protection device● Indicators	<ul style="list-style-type: none">● These fuses are secured firmly.● Surge protection device and indicators can work normally when being activated.

6.2.4 Alarm Reference

For details, see the section “STS Fault Summary” in the document *MS-GS215-2H2 Fault Statistics and Actions*. Scan the QR code to get access to the document.



7 Repair Paint Damage

7.1 Prerequisites

- Do not apply paint in bad weather, such as rain, snow, strong wind, and sandstorm, when there is no shelter outdoors.
- You have prepared the required paint that matches the color palette delivered with equipment.

7.2 Paint Repair Description

The equipment appearance should be intact. If paint has flaked off, repair paint damage immediately.



Check the paint damage on the equipment and prepare appropriate tools and materials. The number of materials depends on site requirements.


7.2.1 Paint repair description

Paint Damage	Tool and Material	Procedure	Description
Slight scratch (steel base material not exposed)	Spray paint or paint, brush (required for repainting a small area), fine sandpaper, anhydrous alcohol, cotton cloth, and paint spray gun (required for repainting a large area)	Steps 1, 2, 4, and 5	<ol style="list-style-type: none">1. For a few scratches, smudges, or rust, manual paint spraying or brushing is recommended.2. For many scratches or large-area smudges and rusts, use a paint spray gun.
Deep scratch (primer damaged, steel base material exposed)	Spray paint or paint, zinc-rich primer, brush (required for repainting a small area), fine sandpaper, anhydrous alcohol, cotton cloth, paint spray gun (required for repainting a large area)	Steps 1, 2, 3, 4, and 5	<ol style="list-style-type: none">3. The paint coating should be thin and even. Paint drops are prohibited on the coating. The surface should be smooth.4. Leave the repainted area for approximately 30 minutes before performing any further operation.
Logo and pattern damage	If a logo or pattern is damaged, provide the logo size and color number. Seek help from a local supplier of advertisement coatings to formulate a repair solution based		


	on the logo size, color, and damage.	
Dent	<p>If a dent is less than or equal to 100 mm² in area and less than 3 mm in depth, fill the dent with Poly-Putty base and then perform the same operations as those for processing deep scratches.</p> <p>If a dent is greater than 100 mm² in area or greater than 3 mm in depth, ask the local supplier for an appropriate repainting solution.</p>	

7.2.2 Procedure


1. Gently polish damaged areas using fine sandpaper to remove smudges or rust.

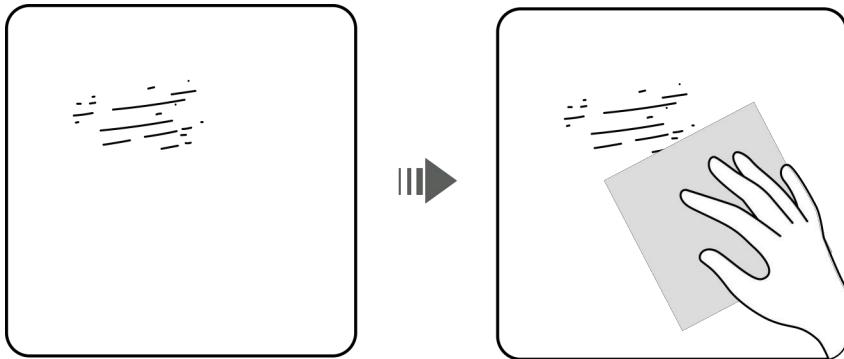

2. Dip a piece of cotton cloth into anhydrous alcohol and wipe the polished or damaged area to remove the dirt and dust. Then wipe off the anhydrous alcohol with a clean and dry cotton cloth.

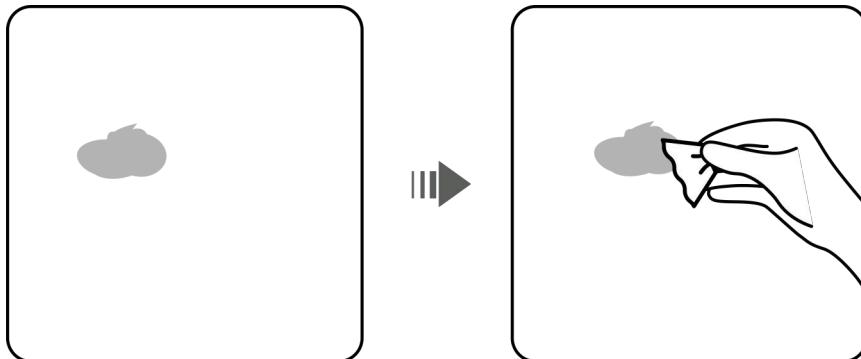

3. Paint zinc-rich primer on the damaged coat using a brush or paint spray gun.

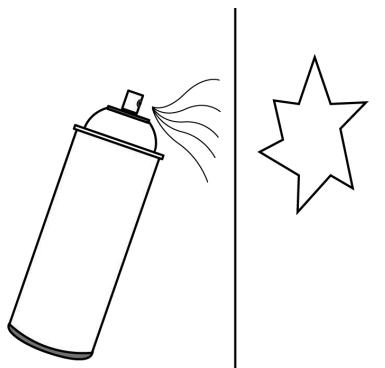


⚠️ Notice!

- If the base material is exposed in the area to be repaired, apply epoxy zinc-rich primer, wait until the paint has dried, and then apply acrylic acid top coat.
- Select epoxy zinc-rich primer or acrylic acid top coat with a color the same as the surface coating color of the equipment.

4. Apply paint evenly to the damaged area based on the damage degree of the paint using an aerosol spray, brush, or paint spray gun until all damage traces are invisible.

⚠️ Notice!

- Ensure that the painting is thin, even, and smooth.
- In the case that an equipment pattern has different colors, to prevent undamaged areas and those with different colors as the damaged area from being contaminated during repainting, cover such areas using white paper and adhesive tape before repairing paint.

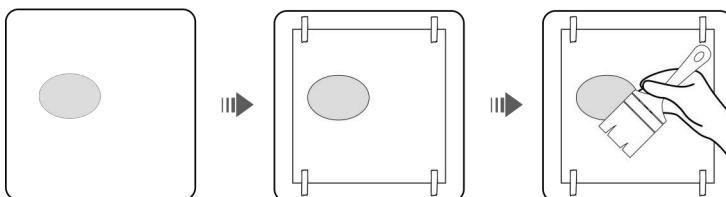

5. Wait for 30 minutes and check whether the painting meets the requirements.

 **Note!**

- The color of the repainted area must be consistent with that of the surrounding area. Make sure that there is no visible edge between the repainted area and the surrounding area. The paint should be free of bulges, scratches, flaking, or cracks.
- If you choose to spray paint, it is recommended that you spray paint three times before checking the result. If the color does not meet the requirements, paint more times until the painting meets the requirements.

8 Emergency Handling

If an accident (including but not limited to the following) occurs on the site, ensure the safety of onsite personnel first and contact the service engineers.

8.1 Strong Impact

- If the equipment has obvious damage or abnormal odor, smoke, or fire occurs, evacuate the personnel immediately, call emergency services, and contact the professionals. The professionals shall use fire extinguishing facilities to extinguish the fire under safety protection.

8.2 Flood

- Power off the system if it is safe to do so.
- If any part of the equipment is submerged in water, do not touch it to avoid electric shock.
- Do not force the equipment that have been soaked in water. Contact the customer service center for help.

8.3 Fire

Suggestions for onsite O&M personnel:

- When a fire occurs, evacuate from the building or equipment area, press the fire alarm bell, and immediately call the fire emergency service. Notify the professional firefighters and provide them with relevant product information, including but not limited to product types, capacity, and so on.
- Do not enter the affected building or equipment area under any circumstances, and do not open the doors of the equipment. Isolate and monitor the site. Keep irrelevant personnel away from the site.
- After calling the fire emergency service, remotely power off the system while ensuring your own safety.
- After professional firefighters arrive, provide relevant product information, including but not limited to product types, capacity, user manuals and so on.
- After the fire is extinguished, the site must be handled by professionals in accordance with local laws and regulations. Do not open the doors of the equipment without permission.
- Post-disaster product maintenance: Contact the service engineers for evaluation.

Suggestions for professional firefighters:

- For product information, see the information provided by O&M personnel, including but not limited to product types, capacity, user manuals and so on.
- Do not open the doors of the equipment before it is deemed safe by professionals.
- Follow local fire fighting regulations.
- When a fire occurs, prevent the fire from spreading to nearby the equipment.


9 Storage

Note!

- Only trained and qualified personnel are allowed to operate the equipment. Wear insulated gloves and use dedicated insulated tools during the operation.
- The storage environment must comply with local regulations and standards.
 - You are advised to store the equipment in a dry, clean, and ventilated indoor environment that is free from sources of strong infrared or other radiations, organic solvents, corrosive gases, and conductive metal dust. Keep the equipment far away from sources of heat and fire.
 - Store the equipment separately to avoid mixing with other equipment. The site must be equipped with qualified fire fighting facilities, such as fire sand and fire extinguishers.
- The equipment must be disconnected from external equipment during storage, and the equipment indicators must be off.

Place the equipment correctly according to the signs on the packing case during storage. Do not place the equipment upside down, lay it on one side, or tilt it.

The packaging signs are described as follows.

Name	Symbol	Description
Up		The package shall be kept upright during transportation and storage.

Fragile		The package contains fragile objects and shall be handled with care.
Keep dry		The package shall be protected against rain, and rainproof measures shall be taken during transportation and storage.
Do not roll		The package shall not be rolled during transportation.
Do not stack		The package shall not be stacked.

- Do not unpack the equipment if it will be stored for a long time.
- Do not stack the equipment.
- Ensure that the ground surface is flat (for long-term or temporary storage).
- Refer to the section “Technical Specification” for storage temperature and humidity.
- Close the cabinet door.
- For long-term storage (more than six months after delivery), replace the desiccants with those of the same specifications and amount.

- If the equipment has been stored for longer than allowed, promptly report the condition to the person in charge.
- Handle the equipment with care to prevent damage.

10 Transport

1. The products should be transported after packaging and during the transportation process. Severe vibration, impact, or extrusion should be prevented to prevent sun and rain. It can be transported using vehicles such as cars, trains, and ships.
2. Always check all applicable local, national, and international regulations before transporting the product.
3. Transporting an end-of-life, damage may, in certain cases, be specially limited or prohibited.
4. Transportation and storage service providers must have the certification for dangerous goods operations required by local laws, regulations, and standards.
5. Before transportation, make a compliant and accurate declaration. Ensure that the packaging, labels, and markings are intact and there is no abnormal smell, leakage, smoke, or fire. Otherwise, the equipment must not be transported.
6. Exercise caution when moving the product to prevent bumping and ensure personal safety.
7. Unless otherwise specified, dangerous goods must not be mixed with goods containing food, medicine, animal feed, or their additives in the same vehicle or container, and sharp objects are not allowed in the same vehicle or container.
Store the product in a separate area away from heat sources. Protect the product from moisture, water, and rain.

11 Technical Specifications

Model	MS-TS500-2-A	MS-BCP500-2-A
Basic parameter		
Rated Current (A)	721A/0.4kV	
Rated Insulation Voltage (V)	DC1000	
Rated Working Voltage (V)	AC400	AC400V/AC230V
Auxiliary Equipment Operating Voltage (V)	AC220, DC24	
Rated Current of Busbar (A)	1000	
Frequency (Hz)	50	
Load Rated Power (kW)	500	
Grid Rated Power (kW)	500	
Rated Power of Oil Engine (kW)	500	\
Switching time (ms)	200	

Dimension (W×D×H,mm)	1000×1000×2250	800×1000×2250
Weight Appr. (kg)	≤740	≤450
System Operating Temperature Range (°C)	-20~55	-20~50
Max. Working Altitude (m)	≤3000	
IP Rating of Enclosure	IP54	
Execution Standards	EN/IEC 61439-1&2	IEC 61439

12 EU Declaration of Conformity



NINGBO DEYE ESS TECHNOLOGY CO. , LTD. confirms herewith that the products described in this document are in compliance with the fundamental requirements and other relevant provisions of the directives mentioned below.



250825051

www.deyeess.com

EU Declaration of Conformity

Product: Junction Panel Cabinet

System model: MS-TS500-2-A、MS-BCP500-2-A

Name and address of the manufacturer: NINGBO DEYE ESS TECHNOLOGY CO., LTD.
No.568, South Rixian Road, Binhai Economic Development Zone, Cixi, Ningbo, Zhejiang, P.R.China

This declaration of conformity is issued under the sole responsibility of the manufacturer. Also this product is under manufacturer's warranty.

This declaration of conformity is not valid any longer: if the product is modified, supplemented or changed in any other way, as well as in case the product is used or installed improperly.

The object of the declaration described above is in conformity with the relevant Union harmonization legislation:

The Electromagnetic Compatibility (EMC) Directive 2014/30/EU; the Low Voltage Directive(LVD) 2014/35/EU.

References to the relevant harmonized standards used or references to the other technical specifications in relation to which conformity is declared:

EN IEC 61000-6-2:2019	●
EN IEC 61000-6-4:2019	●
IEC 61439-1:2011	●
EN 61439-1:2011	●
IEC 61439-2:2011	●
EN 61439-2:2011	●

Nom et Titre / Name and Title:

KunLei Yu
Test Manager

Au nom de / On behalf of:

NINGBO DEYE ESS TECHNOLOGY CO., LTD.

Date / Date (yyyy-mm-dd):

2025-8-25

A / Place :

Ningbo, China

EU DoC -v1

NINGBO DEYE ESS TECHNOLOGY CO., LTD

No.568, South Rixian Road, Binhai Economic Development Zone, Cixi, Ningbo, Zhejiang, P.R.China

Service Hotline: +86-0574-86320560

Email: service-ess@deye.com.cn

Website: <http://deyeess.com>